


NOTES:

- 1) VALVE BOX NOT TO REST ON OPERATING ASSEMBLY.
- 2) OPERATOR EXTENSION REQUIRED WHEN VALVE NUT IS DEEPER THAN 3 FEET FROM FINISHED GRADE.
- 3) CENTER VALVE BOX ON AXIS OF OPER. NUT.
- 4) PROVIDE 24" SQUARE BY 4" THICK CONCRETE PAD AROUND VALVE BOX OUTSIDE OF PAVED AREAS AS SHOWN IN CONCRETE PAD DETAIL

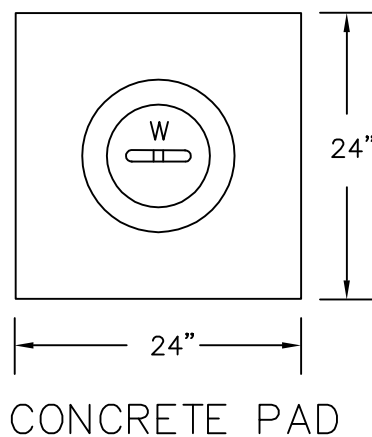

ENGINEERING DEPARTMENT
13125 S.W. HALL BLVD.
TIGARD, OREGON 97223
VOICE: (503) 639-4171
FAX: (503) 684-7297

APPROVED BY:
AGUSTIN P. DUENAS

CITY ENGINEER

MARCH 1998

APPROVAL DATE

**TYPICAL GATE
VALVE**

NO SCALE

DWG. NO.

503